


Lighting Systems **Baselyte-BSL9**

Page 1 of 5

2 Light T8 Wall Mount Direct/Indirect

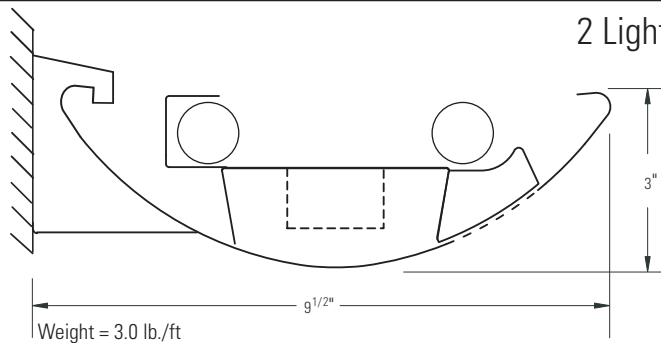

Ordering Information

Family	Distribution	Lamp Type	No. of Lamps	Housing	Module Length	Wiring	Voltage	Ballast	Finish
BSL	8	T	02	CN					
	8 = Wall Mount	T = T8	02 = 2 Light	CN = cutout w/baffles	04 = 4' 08 = 8' 12 = 12'	1 = 1cct. 2 = 2cct. 3 = 1cct. w/EC/NL 4 = 2cct. w/EC/NL 5 = 1cct. w/EM Battery 6 = 2cct. w/EM Battery 7 = 1cct. w/Dimming 8 = 1cct. w/1cct. Thru wire 9 = 2cct. w/1cct. Thru wire Note: Please consult wiring section of spec sheets for more wiring options.	1 = 120V 2 = 277V	E = Standard <20% THD F = Standard <20% THD w/fusing G = <10% THD, Instant Start H = <10% THD, Instant Start w/fusing J = <10% THD, Program Start K = <10% THD, Program Start w/fusing	C = Custom Color W = Standard White

Specifications

Features

1. Housing: die-formed 20ga. cold rolled steel
2. End Set: die-cast metal with baked powder coat finish
3. Lamping: two T8 lamps
4. Configuration: 4', 8' and 12' module lengths or continuous rows
5. Ballasts: electronic 120V or 277V

Finish

High-quality white powder coat with textured matte finish. Custom colors available. Consult factory.

Mounting

Flexible mounting locations.

Electrical

All luminaires are factory pre-wired to module ends with quick-wire connectors.

Joints & Intersections

Self-aligning joining system with hands-free pre-joining wire access.

Labels

UL, CSA standards.

Ordering Instructions

Individual Fixtures

1. Determine the number of individual modules required
2. Order one end set per module
3. Order one non-power mount per module
4. Order one power mount per module

Continuous Rows*

1. Determine run length
2. Order the appropriate number and length of modules for complete run
3. Order one end set for each run
4. Order one non-power mount for each module
5. Order one power mount per run
6. Order one joiner per module minus one (e.g. 3 modules requires 2 joiners)

*Note: Some runs may require additional power mounts. Please see the 'Run Configuration' table on the next page for more details.

Job Information

Type:

Job Name:

Cat. No.:

Lamp(s):

Notes:

Lightolier a Genlyte Company


www.lightolier.com

631 Airport Road, Fall River, MA 02720 • (508) 679-8131 • Fax (508) 674-4710

We reserve the right to change details of design, materials and finish.

© 2005 Genlyte Group LLC • 0205 Rev.1

LIGHTOLIER®




Lighting Systems **Baselyte-BSL9**

Page 2 of 5

2 Light T8 Wall Mount Direct/Indirect

Performance

Candlepower Curve

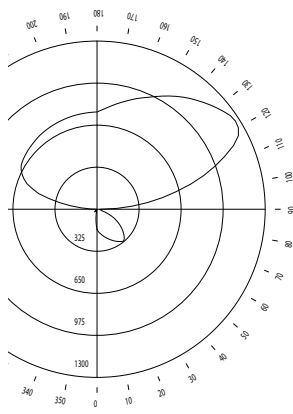

Report No: 9900043

Lamps: F32T8

Lumens per Lamp: 2950

Efficiency: 69.8%

Up: 89.1% Down: 10.9%

Candlepower Summary

ZONE DEG.	0	45	90	135	180
180	752	752	752	752	752
175	784	772	748	749	750
165	866	816	723	734	744
155	956	854	675	707	736
145	1065	885	606	667	726
135	1167	908	517	624	709
125	1260	915	410	574	691
115	1164	926	292	527	639
105	749	689	162	414	467
95	272	248	41	122	123
90	29	27	3	6	5
85	22	23	8	4	3
75	35	53	18	4	4
65	122	127	26	6	4
55	218	199	45	19	8
45	296	230	70	23	25
35	305	224	96	17	21
25	263	213	120	11	11
15	221	196	140	28	8
5	180	175	153	110	93
0	155	155	155	155	155


Coefficients of Utilization

		% EFFECTIVE CEILING CAVITY REFLECTANCE								
		80			70			50		
		% WALL REFLECTANCE								
		50	30	10	50	30	10	50	30	10
0		68	68	68	59	59	59	43	43	43
1		59	56	54	51	49	47	37	36	35
2		51	47	44	45	41	39	32	30	28
3		45	40	36	39	35	32	28	26	24
4		39	34	30	34	30	27	25	22	20
5		35	30	26	30	26	23	22	19	17
6		31	26	22	27	23	19	20	17	14
7		28	23	19	24	20	17	18	15	12
8		25	20	16	22	17	14	16	13	11
9		23	18	14	20	16	13	14	11	9
10		20	16	13	18	14	11	13	10	8

Zonal Lumen Summary

ZONE	LUMENS	% BARE LAMP	% LUMINAIRE
0-90	448	7.6	10.9
90-180	3670	62.2	89.1
0-180	4118	69.8	100.0

Module Lengths & Mounting Distances

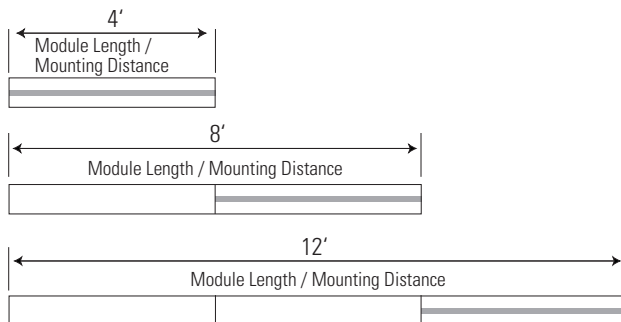

Note: Shaded area indicates locations of emergency sections (emergency wiring controls all lamps or optional battery pack controls one or two lamps).


Run Configuration

Run Length	4' Module	8' Module	12' Module	Joiner	End Set	Mount	Power Mount*
4' run	1				1	1	1
8' run		1			1	1	1
12' run			1		1	1	1
16' run		2		1	1	2	1
20' run		1	1	1	1	2	1
24' run			2	1	1	2	1
28' run		2	1	2	1	3	1
32' run		1	2	2	1	3	1

***Note:** Additional power mounts may be required for some runs with T5 HO lighting options, longer runs, and runs with wiring options that are more complex. Please consult factory for assistance.


System Components & Accessories

End Set




BSLEWW = wall mount standard white

Joiner




BSLJW = wall mount joiner

Non-Power Wall Mount




BSLWN = non-power wall mount

Power Wall Mount

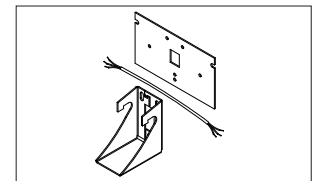

BSLWP1 = 1-power mount
BSLWP2 = 2-power mount

Dust Cover



BSLDCW = 4' wall mount dust cover

Job Information

Type:

Lightolier a Genlyte Company


www.lightolier.com

631 Airport Road, Fall River, MA 02720 • (508) 679-8131 • Fax (508) 674-4710

We reserve the right to change details of design, materials and finish.

© 2005 Genlyte Group LLC • 0205 Rev.1

LIGHTOLIER



Wiring Options: 1 Circuit

1 Circuit


- ☐ **Type 1:** 1cct.
- ☐ **Type 8:** 1cct. w/1cct. thru wire
- ☐ **Type H:** 1cct. w/2cct. thru wire
- ☐ **Type 7:** 1cct. w/dimming



All lamps wired on one circuit.

1 Circuit with Emergency Circuit/Night Light (EC/NL)

- ☐ **Type 3:** 1cct. w/EC/NL



One 4' section in a one circuit fixture to be wired on a separate thru circuit. Leads for both normal circuit and EC/NL circuit wired to fixture ends. All lamps in EC/NL section to be wired together.

1 Circuit with Emergency Battery Pack (EM)

- ☐ **Type 5:** Chloride standard C700A
- ☐ **Type M:** Bodine standard B70A
- ☐ **Type E:** Chloride high performance C1400
- ☐ **Type P:** Bodine high performance B50



All lamps wired on one circuit, plus a battery pack is wired to one lamp. A hot lead is connected to the battery pack and would function as a 'trigger' wire when connected to a constant hot by installer. Leads for both normal circuit and battery pack are wired to fixture ends.

**Note: Multi-lamp battery packs are also available.*

1 Circuit with Emergency Circuit/Night Light and Emergency Battery Pack

- ☐ **Type J:** Chloride standard C700A



One 4' section in a one circuit fixture to be wired on a separate thru circuit, in addition, a battery pack is wired to one lamp. Installer can connect 'trigger' wire to EC hot lead if controlled together or wire separately if controlled independently. Leads for normal circuit, EC/NL and EM wired to fixture ends. All lamps in EC/NL section to be wired together.

**Note: Multi-lamp battery packs are also available.*

Job Information

Type:


Lightolier a Genlyte Company

www.lightolier.com

631 Airport Road, Fall River, MA 02720 • (508) 679-8131 • Fax (508) 674-4710

We reserve the right to change details of design, materials and finish.


© 2005 Genlyte Group LLC • 0205 Rev.1



Wiring Options: 2 Circuit Left/Right Switching

2 Circuit Left/Right Switching


- ☐ **Type 2:** 2cct.
- ☐ **Type 9:** 2cct. w/1cct. thru wire
- ☐ **Type I:** 2cct. w/2cct. thru wire



Fixture wired for two circuit. Lamps wired for left/right switching.

2 Circuit Left/Right Switching with Emergency Circuit/Night Light (EC/NL)


- ☐ **Type 4:** 2cct. w/EC/NL



One 4' section in two circuit fixture (left/right switching) to be wired on a separate thru circuit. Leads for both normal circuit and EC/NL circuit wired to fixture ends. All lamps in EC/NL section to be wired together.

2 Circuit Left/Right Switching with Emergency Battery Pack (EM)

- ☐ **Type 6:** Chloride standard C700A
- ☐ **Type N:** Bodine standard B70A
- ☐ **Type F:** Chloride high performance C1400
- ☐ **Type Q:** Bodine high performance B50




Fixture wired for two circuits (left/right switching), plus a battery pack is wired to one lamp. A hot lead is connected to the battery pack and would act as a 'trigger' wire when connected to a constant hot by installer. Leads for both normal circuit and battery pack are wired to fixture ends.

**Note: Multi-lamp battery packs are also available.*

2 Circuit Left/Right Switching with Emergency Circuit/Night Light and Emergency Battery Pack

- ☐ **Type K:** Chloride standard (C700A for T8, CTP700 for T5 HO)




One 4' section in a two circuit fixture (left/right switching) to be wired on a separate thru circuit, in addition, a battery pack is wired to one lamp. Installer can connect 'trigger' wire to EC hot lead if controlled together or wired separately if controlled independently. Leads for normal circuit, EC/NL and battery pack are wired to fixture ends. All lamps in EC/NL section to be wired together.

**Note: Multi-lamp battery packs are also available.*

Job Information

Type:


Lightolier a Genlyte Company www.lightolier.com
 631 Airport Road, Fall River, MA 02720 • (508) 679-8131 • Fax (508) 674-4710
 We reserve the right to change details of design, materials and finish.
 © 2005 Genlyte Group LLC • 0205 Rev.1



Wiring Options: 2 Circuit A/B Switching (alternate 4' sections)

2 Circuit A/B Switching (alternate 4' sections)


- ☐ **Type B:** 2cct. A/B
- ☐ **Type A:** 2cct. A/B w/1cct. thru wire
- ☐ **Type S:** 2cct. A/B w/2cct. thru wire



Fixture wired for two circuit. Lamps wired for A/B switching in alternate 4' sections.

2 Circuit A/B Switching (alternate 4' sections) with Emergency Circuit/Night Light (EC/NL)


- ☐ **Type C:** 2cct. w/EC/NL



One 4' section in a two circuit fixture (A/B switching) to be wired on a separate thru circuit. Leads for both normal circuit and EC/NL circuit wired to fixture ends. All lamps in EC/NL section to be wired together.

2 Circuit A/B Switching (alternate 4' sections) with Emergency Battery Pack (EM)

- ☐ **Type D:** Chloride standard
C700A
- ☐ **Type O:** Bodine standard
B70A
- ☐ **Type G:** Chloride high performance
C1400
- ☐ **Type R:** Bodine high performance
B50




Fixture wired for two circuits (A/B switching), plus a battery pack is wired to one lamp. A hot lead is connected to the battery pack and would act as a 'trigger' wire when connected to a constant hot by installer. Leads for both normal circuit and battery pack are wired to fixture ends.

**Note: Multi-lamp battery packs are also available.*

2 Circuit A/B Switching (alternate 4' sections) with Emergency Circuit/Night Light and Emergency Battery Pack

- ☐ **Type L:** Chloride standard
C700A



One 4' section in a two circuit fixture (A/B switching) to be wired on a separate thru circuit, in addition, a battery pack is wired to one lamp. Installer can connect 'trigger' wire to EC hot lead if controlled together or wired separately if controlled independently. Leads for normal circuit, EC/NL circuit and battery pack are wired to fixture ends. All lamps in EC/NL section to be wired together.

**Note: Multi-lamp battery packs are also available.*

Job Information

Type:

Lightolier a Genlyte Company www.lightolier.com
 631 Airport Road, Fall River, MA 02720 • (508) 679-8131 • Fax (508) 674-4710
 We reserve the right to change details of design, materials and finish.
 © 2005 Genlyte Group LLC • 0205 Rev.1